

1 L1

3 L2

5 L3

13 NO

21 NC



TUV Rheinland

KTC
HU03040.10004

NO 43

NC 31

SC-N7 [152]

SC1FBAA US Cat. No. 3NC4F


MC40F



JIS C 8201

AC-3-1-1-0

V~	kW	A
240	37	152
440	75	150
550	75	120



V~	HP (3PH)	SCCR	CB Max. Rating	Fuse Max. Rating
200	50	50kA	250A	SCCR 10kA K5, RK5 200A
220-240	50			
440-480	100	18/25kA	250/125A	
550-600	125	10kA	225A	

IEC/EN 60847
VDE 0660
GB 14048.4
NK 99T408

AC-3

Ue V~	kW	A
240*	45	150
440*	75	150
550	75	120
690	90	103

AC-1=Ith=200A
(Main) Uimp=8kV
Ui=1000V

Continuous current 200A
Aux. Cont. A600 Q300
75°C Wire Cu Only. Break All Lines.
See instruction sheet enclosed for wiring and
further information on the selection of CB or Fuse.

22 NC

14 NO

NC 32

NO 44

Fuji Electric FA

Made in Japan

2 T1


4 T2

6 T3







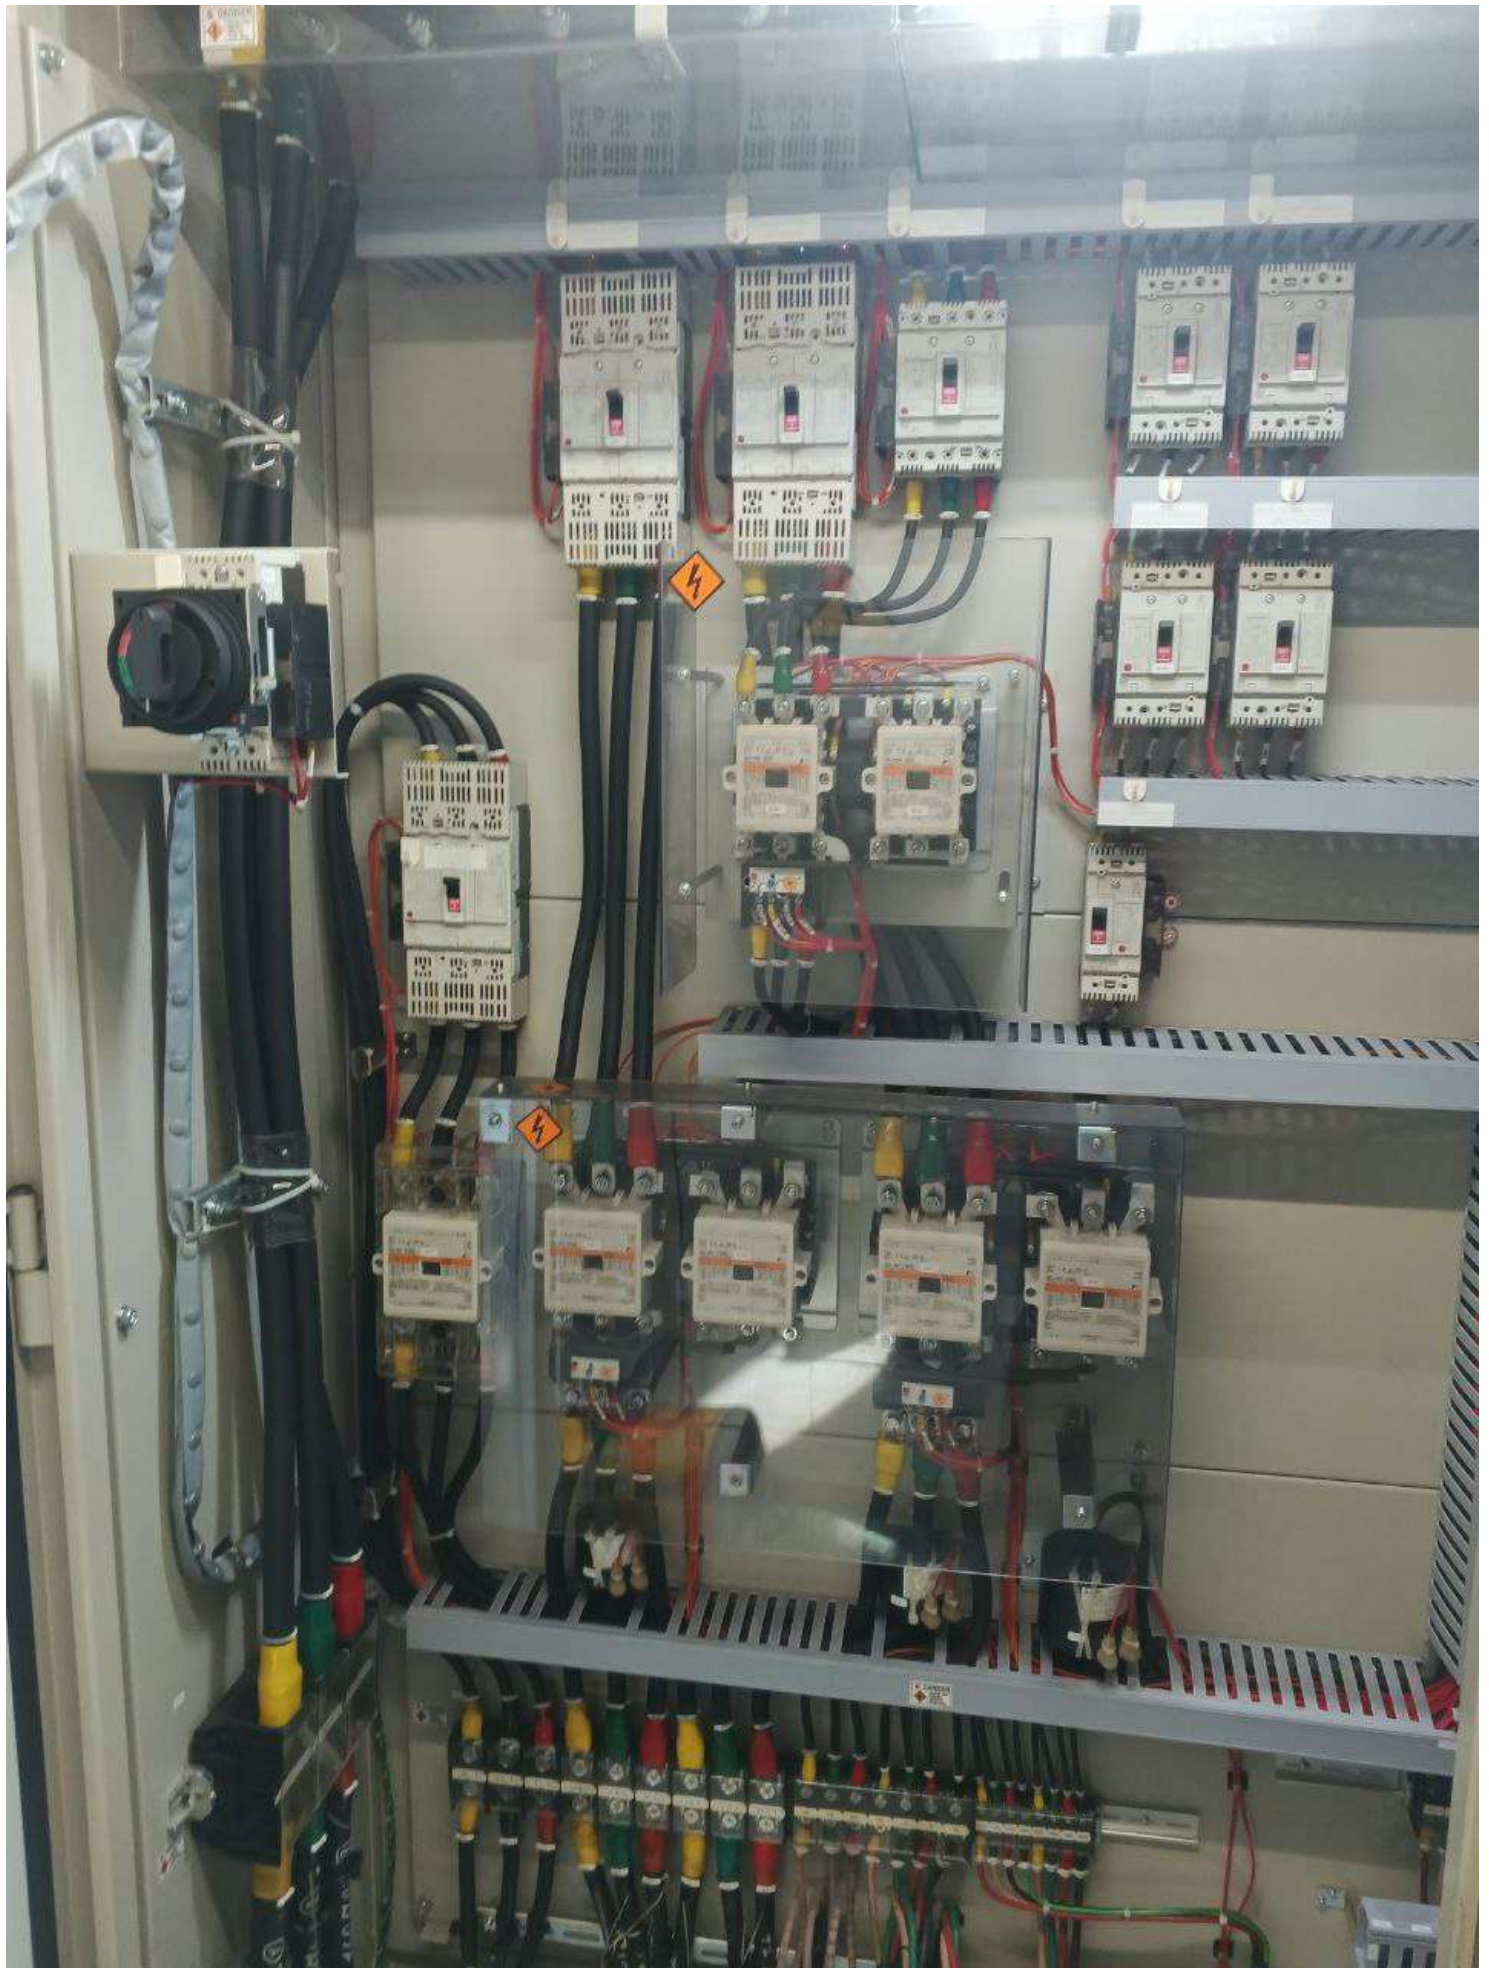



ПРИ ПОЖАРЕ
ЗВОНИТЬ
665-301



В ХО
ПЕРИ
ОБОГ
НЕ ОТ

